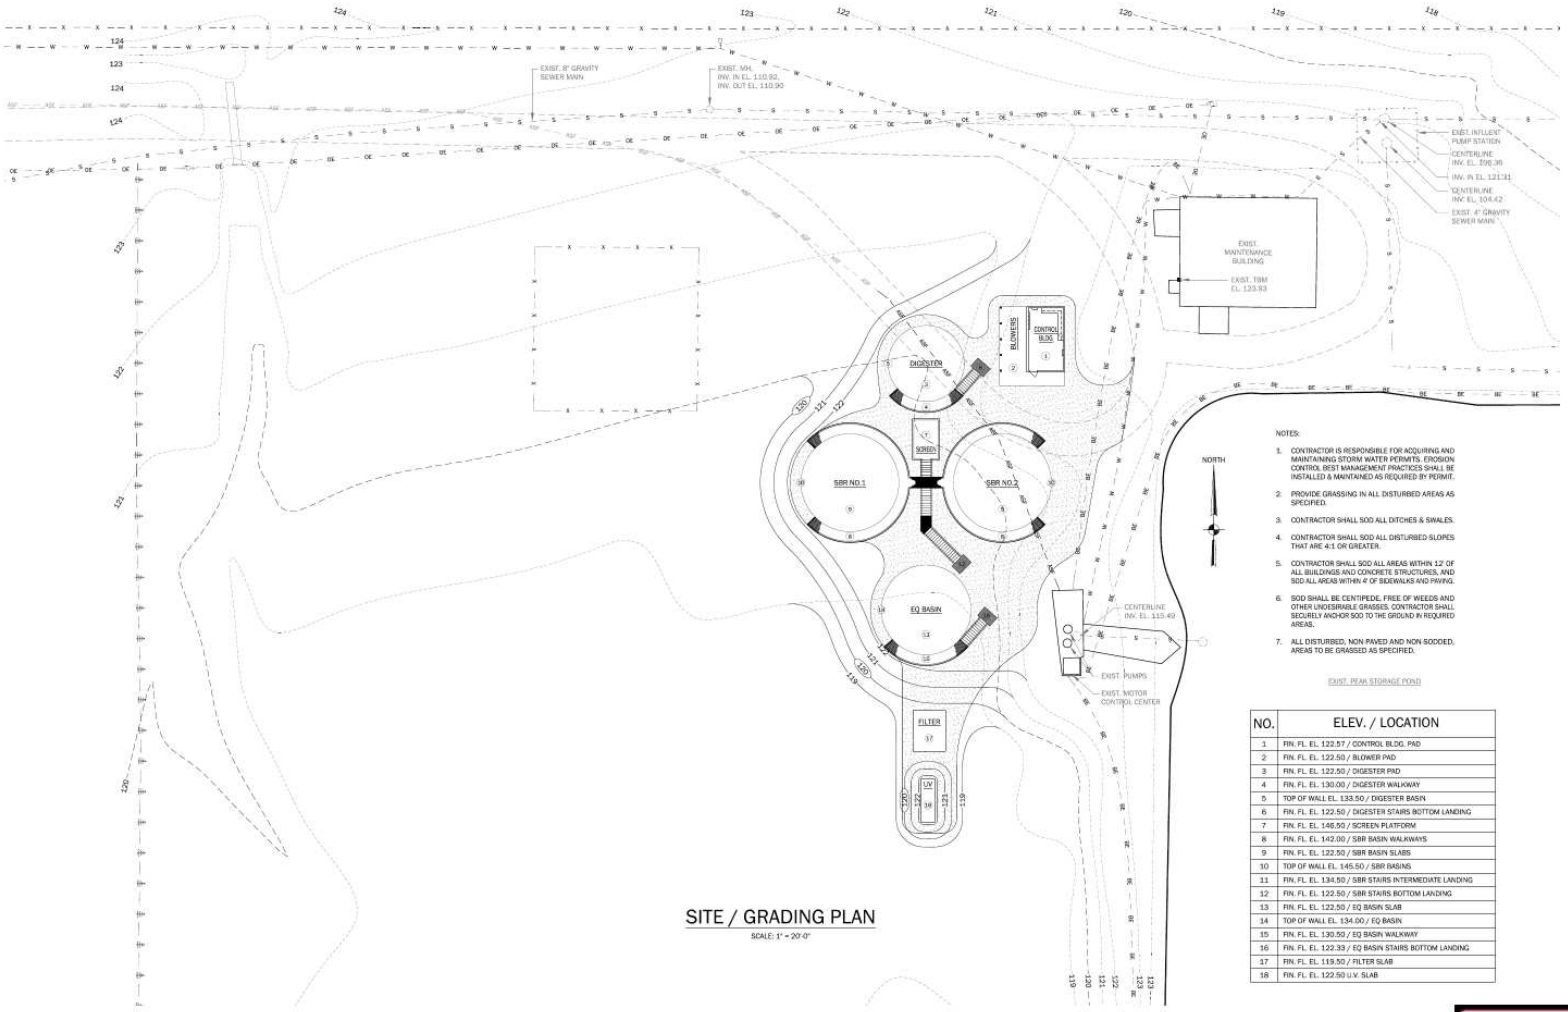

SITE / GRADING PLAN

SCALE: 1" = 20'-0"

NOTES:

1. CONTRACTOR IS RESPONSIBLE FOR ACQUIRING AND MAINTAINING STORM WATER PERMITS. EROSION CONTROL BEST MANAGEMENT PRACTICES SHALL BE INSTALLED & MAINTAINED AS REQUIRED BY PERMIT.
2. PROVIDE GRASSING IN ALL DISTURBED AREAS AS SPECIFIED.
3. CONTRACTOR SHALL SOD ALL DITCHES & SWALES.
4. CONTRACTOR SHALL SOD ALL DISTURBED SLOPES THAT ARE 4:1 OR GREATER.
5. CONTRACTOR SHALL SOD ALL AREAS WITHIN 12' OF ALL BUILDINGS AND CONCRETE STRUCTURES, AND SOD ALL AREAS WITHIN 4' OF SIDEWALKS AND PAVING.
6. SOD SHALL BE CENTIPEDE, FREE OF WEEDS AND OTHER UNDESIRABLE GRASSES. CONTRACTOR SHALL SECURELY ANCHOR SOD TO THE GROUND IN REQUIRED AREAS.
7. ALL DISTURBED, NON-PAVED AND NON-SODDED, AREAS TO BE GRASSED AS SPECIFIED.

EXIST. PEAK STORAGE POND

NO.	ELEV. / LOCATION
1	FIN. FL. EL. 122.57 / CONTROL BLDG. PAD
2	FIN. FL. EL. 122.50 / BLOWER PAD
3	FIN. FL. EL. 122.50 / DIGESTER PAD
4	FIN. FL. EL. 130.00 / DIGESTER WALKWAY
5	TOP OF WALL EL. 133.50 / DIGESTER BASIN
6	FIN. FL. EL. 122.50 / DIGESTER STAIRS BOTTOM LANDING
7	FIN. FL. EL. 146.50 / SCREEN PLATFORM
8	FIN. FL. EL. 142.00 / SBR BASIN WALKWAYS
9	FIN. FL. EL. 122.50 / SBR BASIN SLABS
10	TOP OF WALL EL. 145.50 / SBR BASINS
11	FIN. FL. EL. 134.50 / SBR STAIRS INTERMEDIATE LANDING
12	FIN. FL. EL. 122.50 / SBR STAIRS BOTTOM LANDING
13	FIN. FL. EL. 122.50 / EQ BASIN SLAB
14	TOP OF WALL EL. 134.00 / EQ BASIN
15	FIN. FL. EL. 130.50 / EQ BASIN WALKWAY
16	FIN. FL. EL. 122.33 / EQ BASIN STAIRS BOTTOM LANDING
17	FIN. FL. EL. 119.50 / FILTER SLAB
18	FIN. FL. EL. 122.50 U.V. SLAB

DISCLAIMER

These drawings, and the information contained herein, are for general presentation purposes only, and are not intended, nor should be used, for engineering design plans.